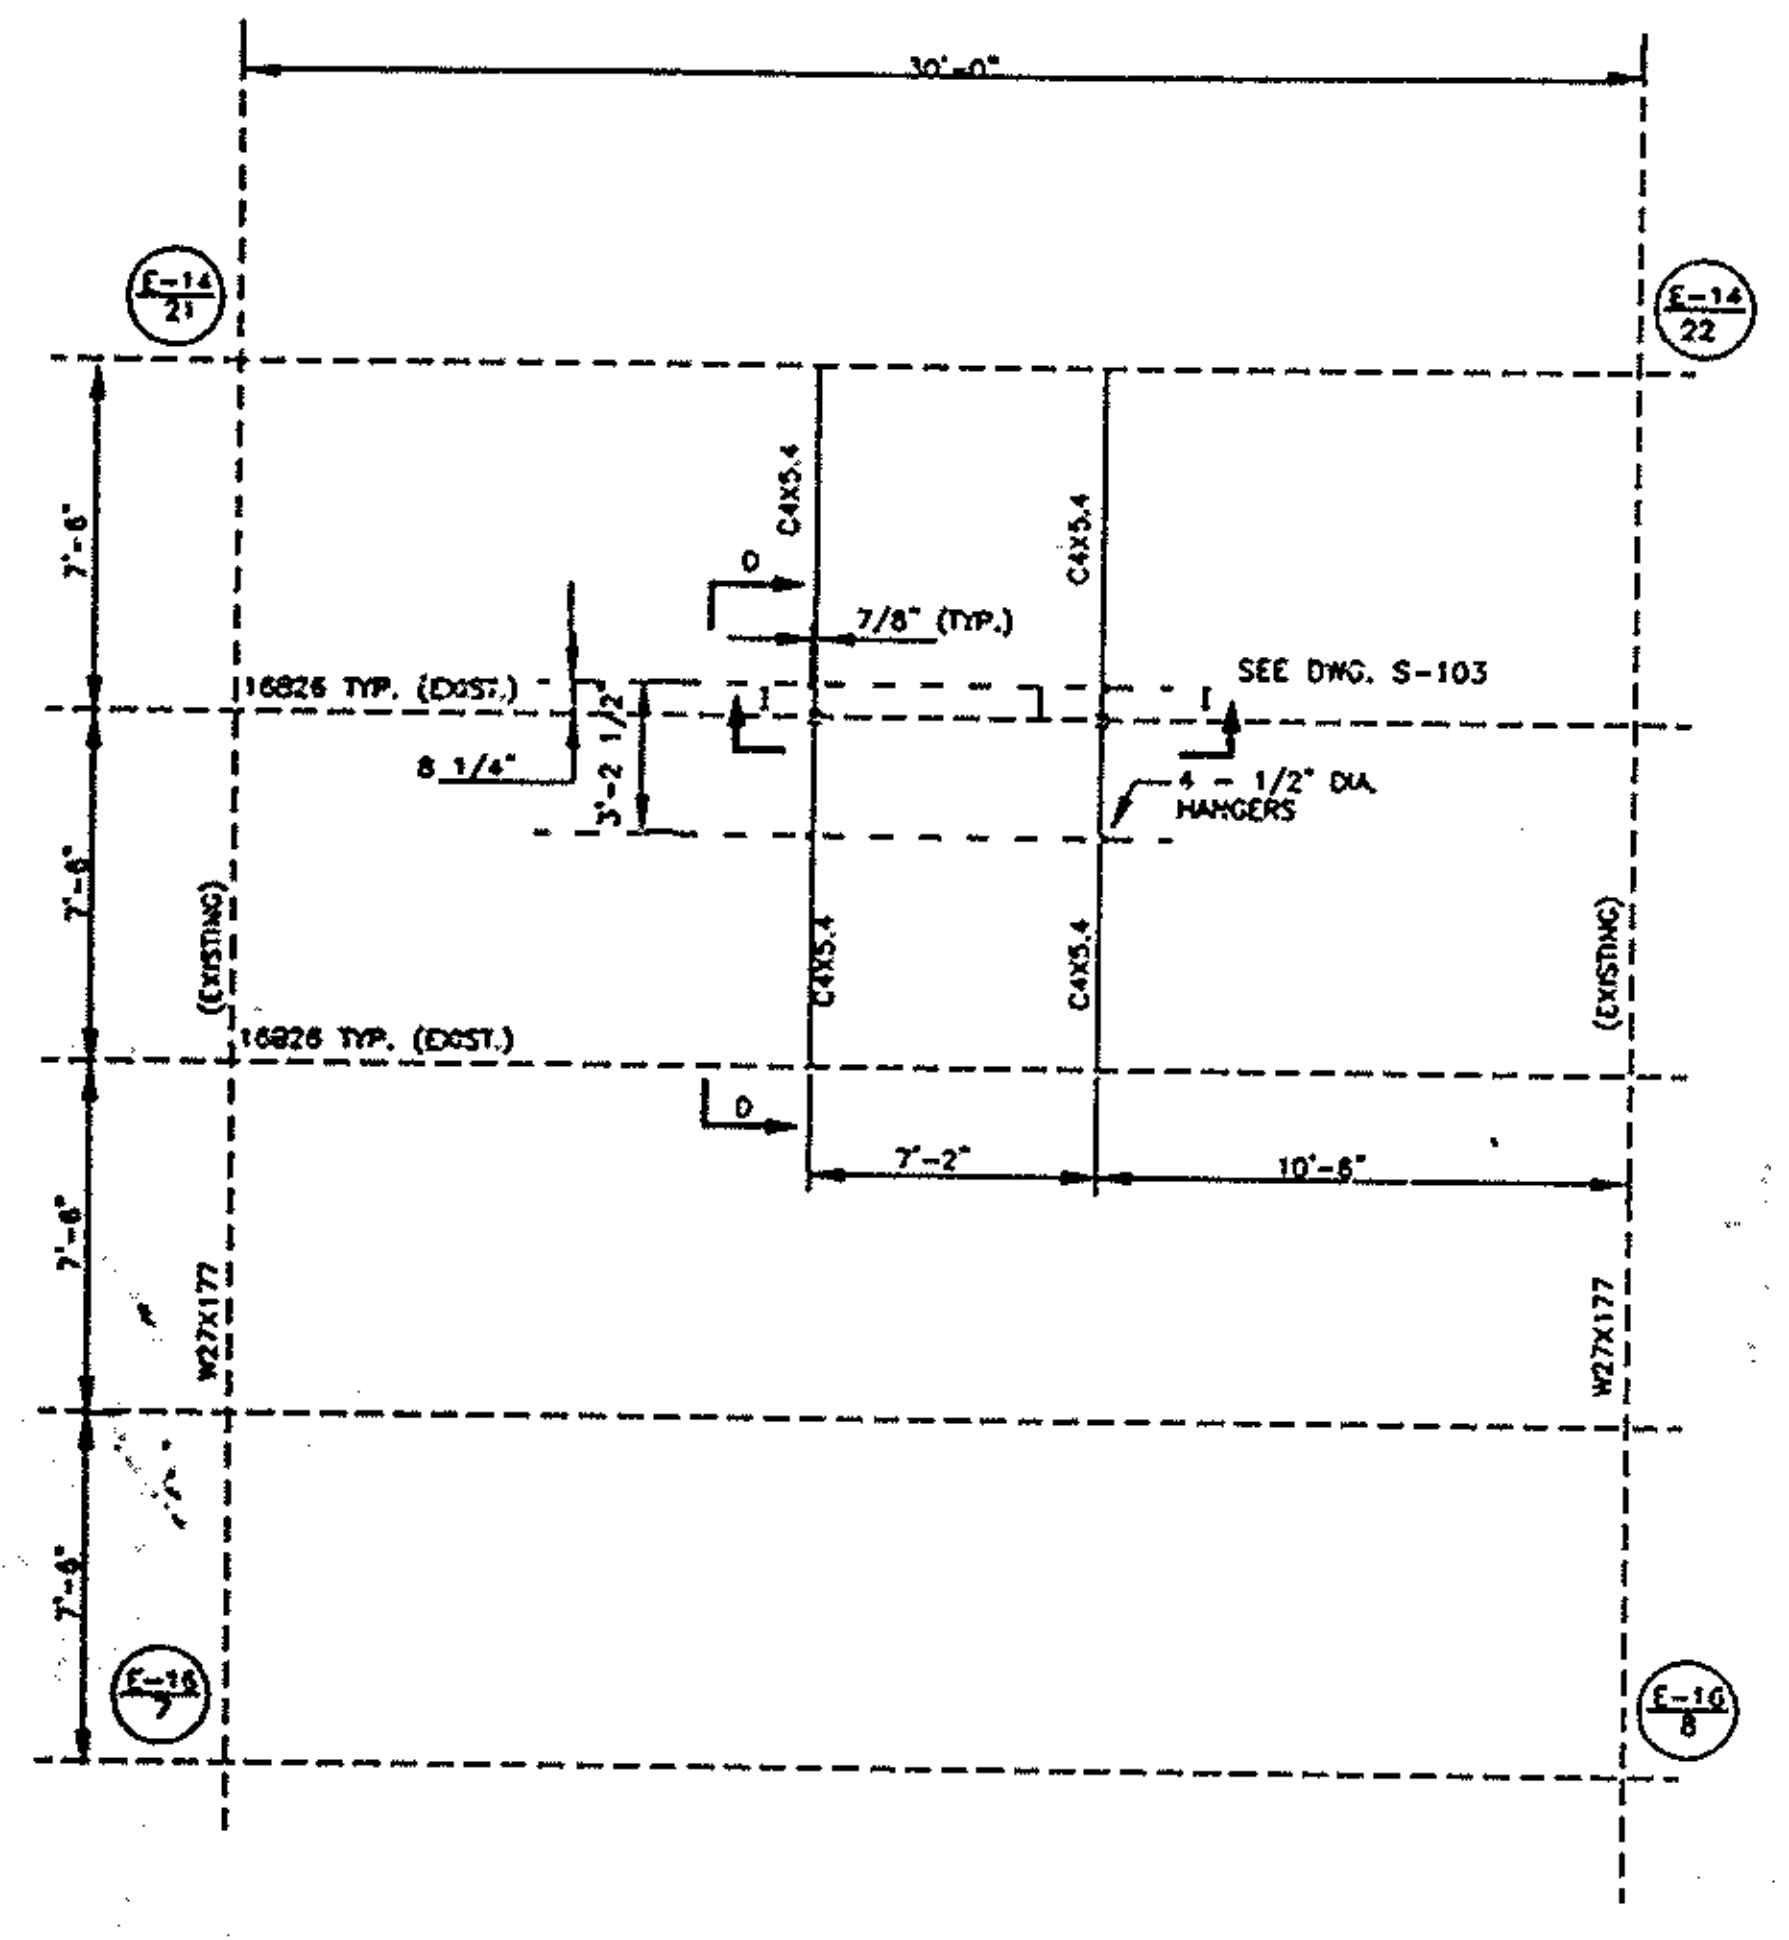

PARTIAL ROOF PLAN – AC UNIT (AC-1) (10th FLOOR)

SCALE IN FEET

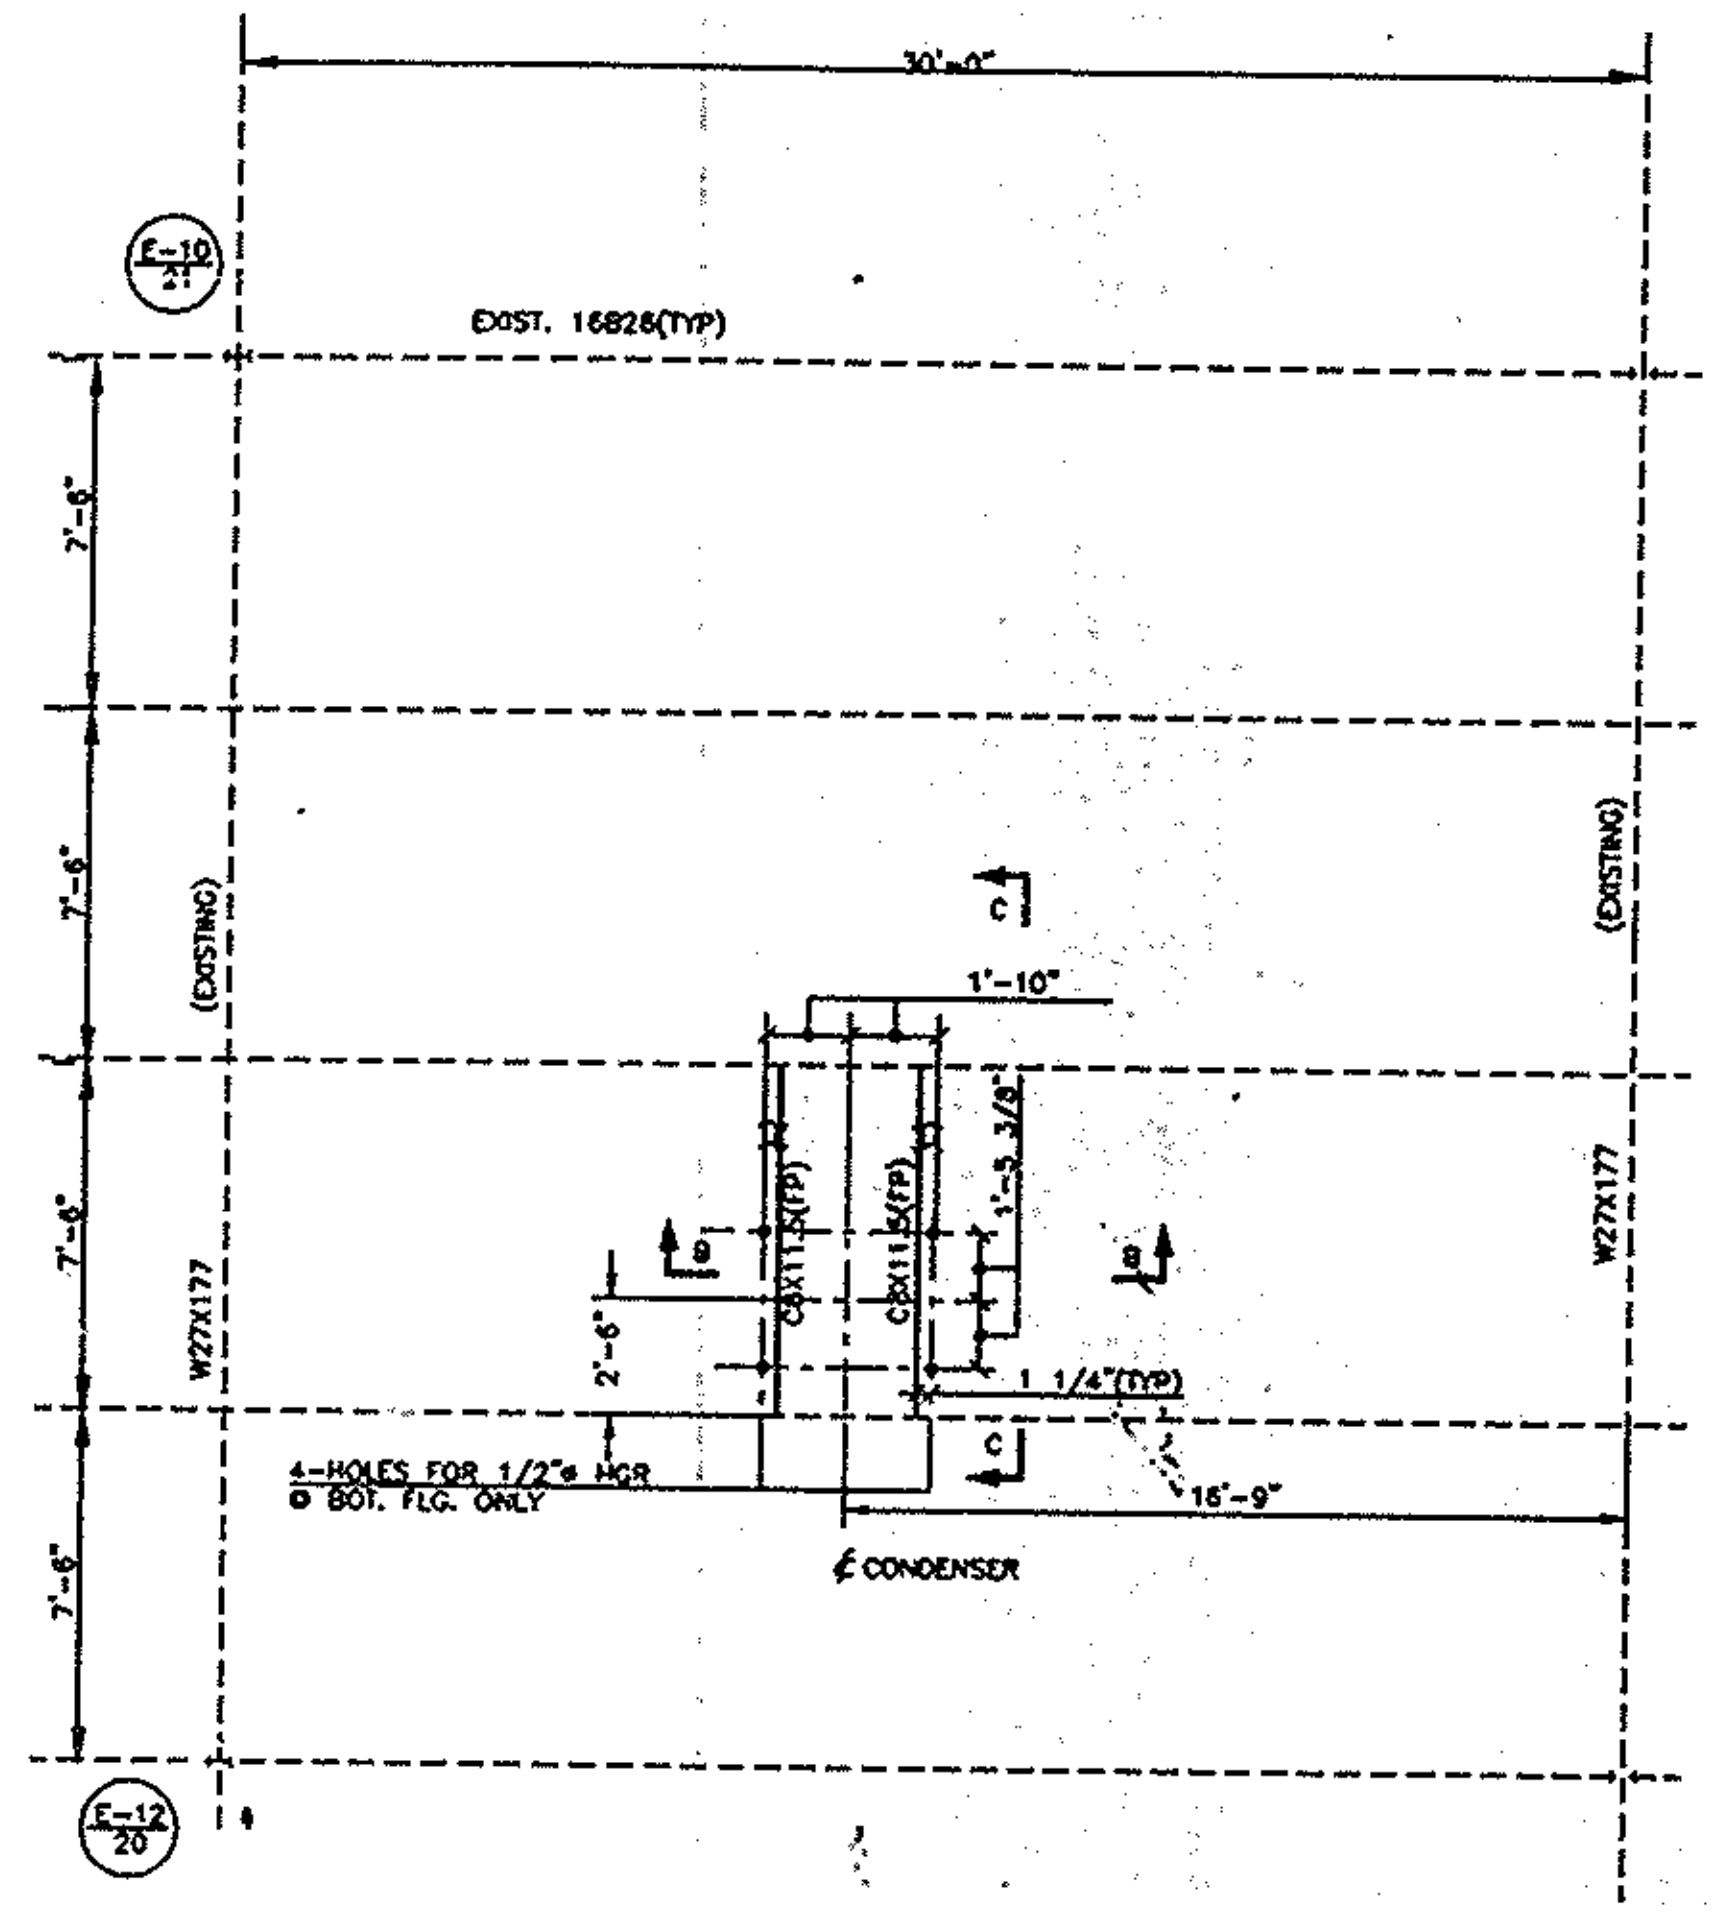

PARTIAL ROOF PLAN – CONDENSER SUPPORT (10th FLOOR LEVEL)

SCALE IN FEET

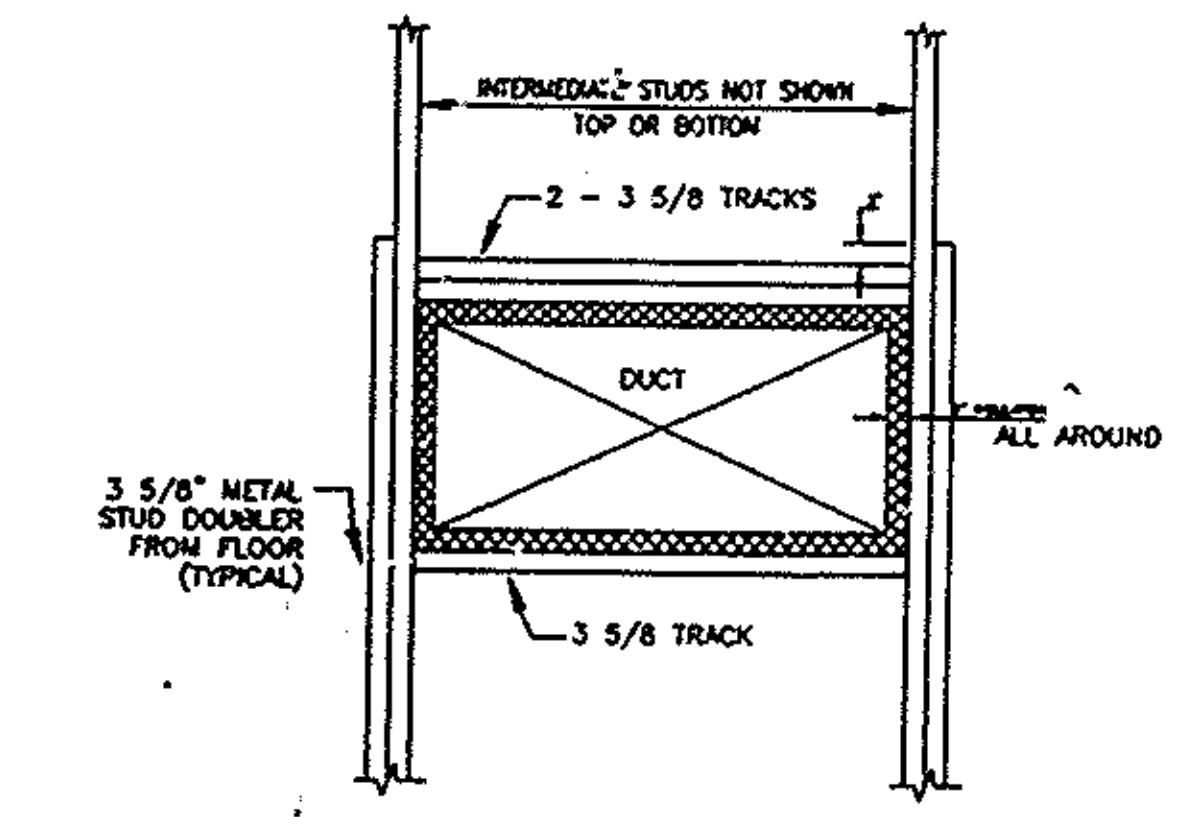

FOR OTHER DRYWALL DETAILS, SEE ARCHITECTURAL DWG. A-801.
FIELD VERIFY THE EXACT DIMENSION OF DUCT WITH INSULATION.
SEAL ALL AROUND THE OPENING WITH FIRESTOP SEALANT SUCH AS DOW CORNING CATALOG #2000 OR APPROVED EQUAL.
DUCT SHALL NOT BE SUPPORTED FROM DRYWALL.

DUCT FRAMING DETAIL

(NOT TO SCALE)

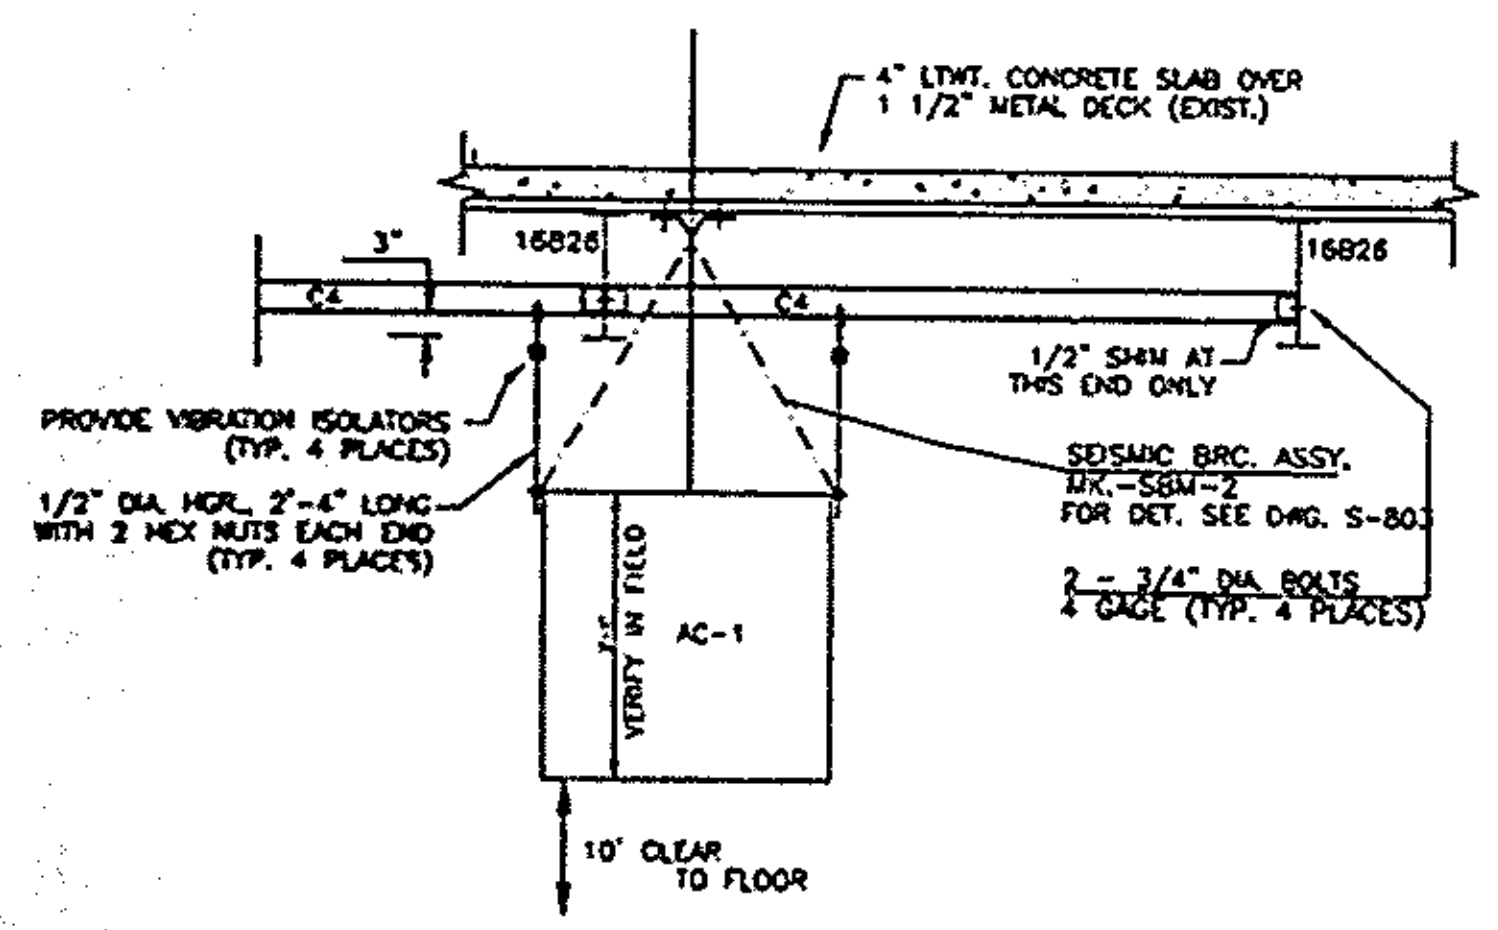

SECTION D–D (TYP. 2 PLACES)

SCALE IN FEET

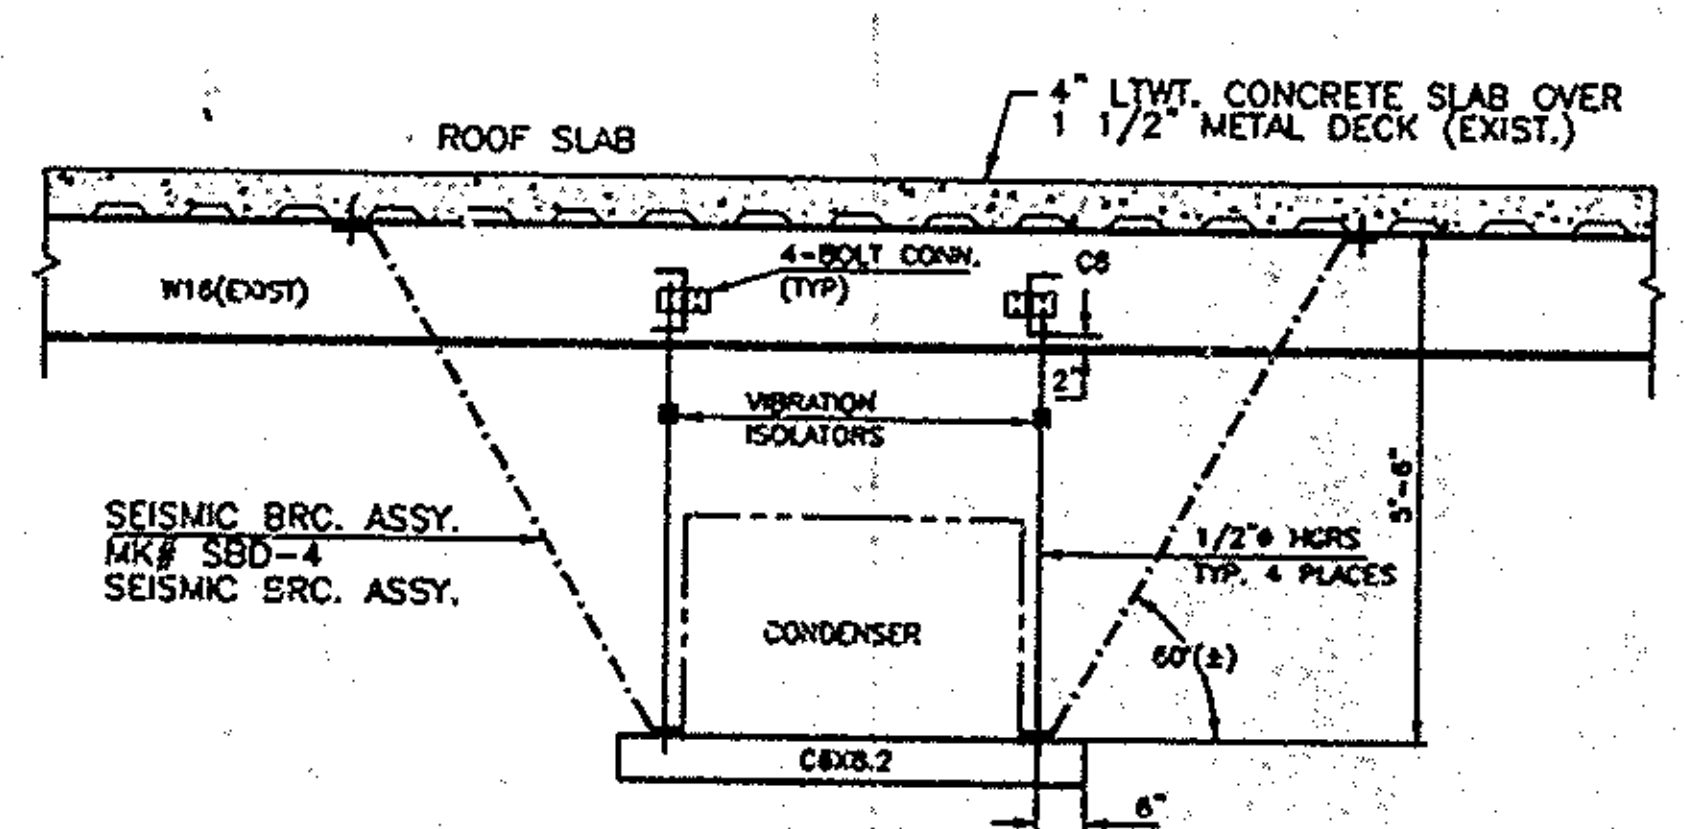

SECTION B–B TYP. 2 PLACES

SCALE IN FEET

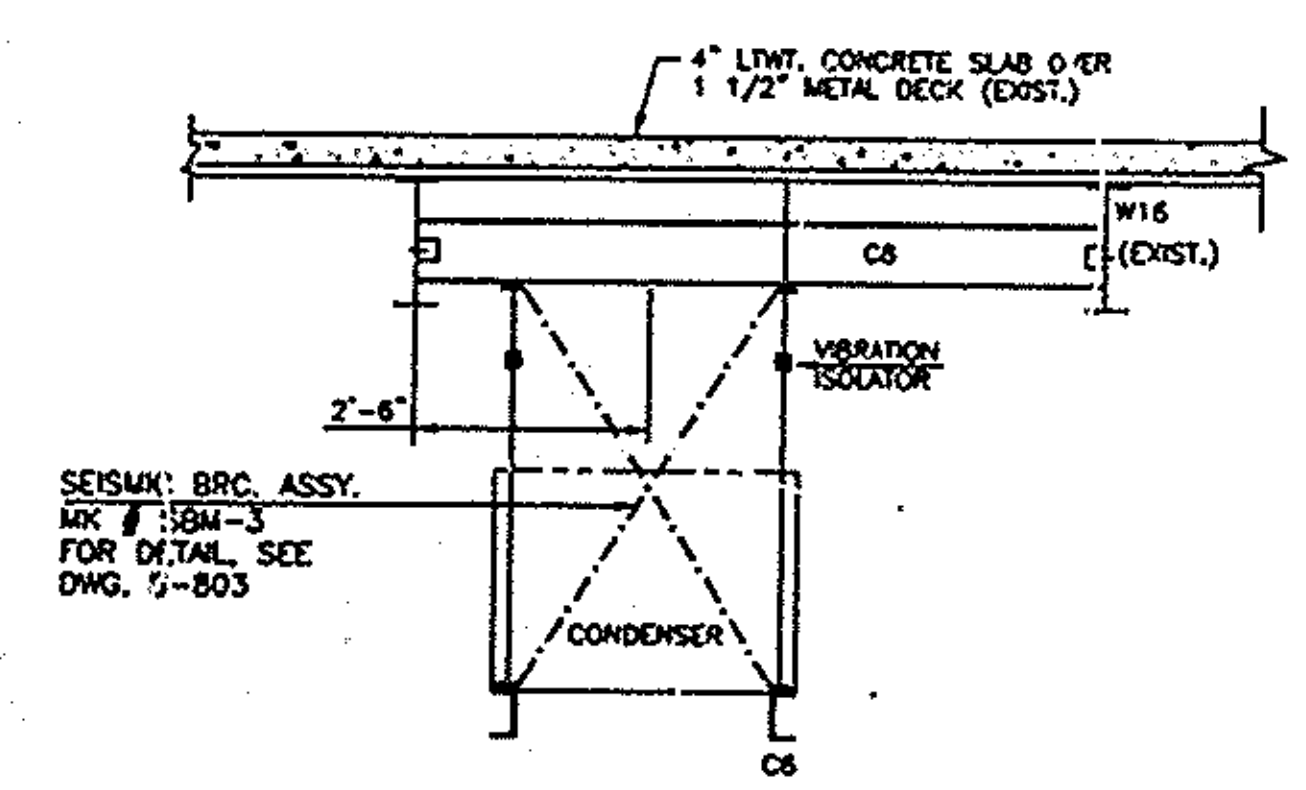

SECTION C–C

SCALE IN FEET

Sheet 91 of 110

THE PORT AUTHORITY OF NY & NJ

ORIGINAL SIGNED & SEALED BY N.Y. P.E. (OR R.A.)

Ram Communications Consultants, Inc.
10 Woodbridge Center Drive
Woodbridge, NJ 07095
(908) 636-6970 fax (908) 636-7260

XENON CO.
– CONSULTING ENGINEERS –
Suite #7, 129 Park Avenue
Plainfield, New Jersey, 07060
Tele: (908) 755 4445
Fax: (908) 755 4446

XENON Job No U-98-07 File Name S-801

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. WTC-945.071 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 1/16/98 SPEC. WRITER

DATE 4/10/98 ENGINEER OF DESIGN

No.	Date	Revision	Approved

The World Trade Center

Title

STANDBY POWER
5 WORLD TRADE CENTER

COMMUNICATIONS

AC UNIT AND CONDENSER SUPPORT

A.S.	S.C	A.S.
Designed by	Drawn by	Checked by

Date

Scale AS NOTED

Contract Number WTC-945.071

Drawing Number S-802